

Adjustable Door Stop -Part 599C

PART: 599C

Weatherstrips, Adjustable Door Stop

Available Inserts: Neoprene


1-1/2" x 7/8"

FIRE RATED – UL10B FIRE TESTED.

POSITIVE PRESSURE – CATEGORY J LISTED, UL10C
POSITIVE PRESSURE TEST.

SMOKE AND DRAFT CONTROL TEST – CATEGORY H
LISTED, UL-1784. FOR USE ON "S" LABELED DOORS.
SOUND TEST – ASTM STANDARD E90-75.

AIR INFILTRATION TEST – E283-73 AND SDI 116 AIR.

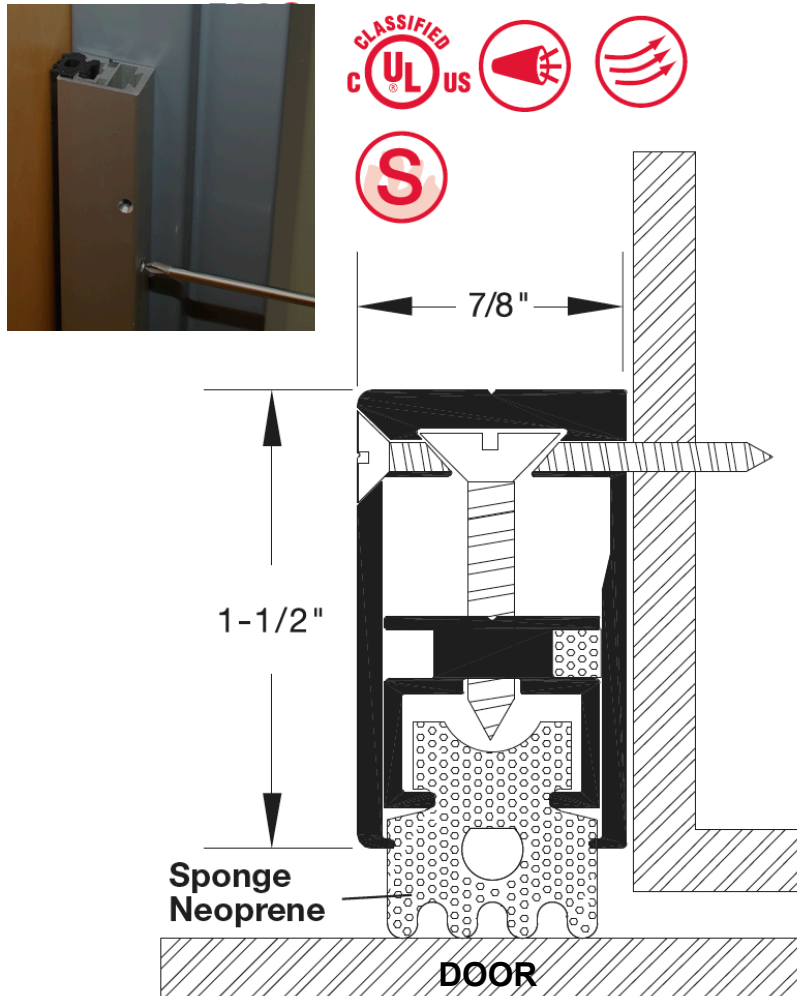

PLEASE NOTE:

These products have been fire rated for use as perimeter seals only and shall not be used in lieu of an integral pressed steel stop on fire rated installations.

For heavy duty use, The 599C features a captive adjustment screw drilled and tapped into the solid bar.

One side of each piece mitered.

Where adjustable door stops are applied on top of existing stops, it is recommended that locks with 3-3/4" backsets be used rather than locks with a 2-3/4" backset. This allows adequate space between the door knob and the weatherstrip.

NOTE:

The Soundproofing Company presents these construction concepts with the understanding that local Building Codes vary. It is the responsibility of the installer to ensure that these concepts meet local Building Code. The Soundproofing Company is not liable for mis-installation or non-compliance with local code. Drawing not to scale.